



STANDARD BEDDING

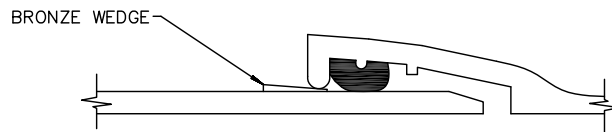


AFTER JOINT ASSEMBLY, TWO SERRATED BRONZE WEDGES SHALL BE INSERTED IN THE BELL 180° APART AT THREE AND NINE O'CLOCK.

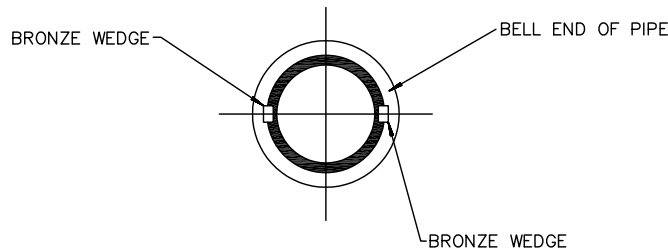

BRONZE CONDUCTIVITY WEDGE

NOTES:

Refer to other Standard Details for the remaining parts of the water main. Also, refer to the Contract Specifications. At no time are these details to supersede but rather to work in conjunction with other standards and specifications.

	CITY OF HOLLAND, MICHIGAN Holland Board of Public Works Water & Wastewater Department 625 Hastings Ave., Holland, MI 49423 Phone: (616) 355-1643 - Fax: (616) 355-1560 Director: John Van Uffelen, P.E.	BEDDING & CONDUCTIVITY STANDARD DETAIL			
		DRAWN BY	SCALE	DATE	
		ARP	NONE	10-17-2006	
		APPROVED BY	SHEET	DWG FILE	
DJS	WM-2	BED & CONDUCTIVITY.dwg			